



Machine Room

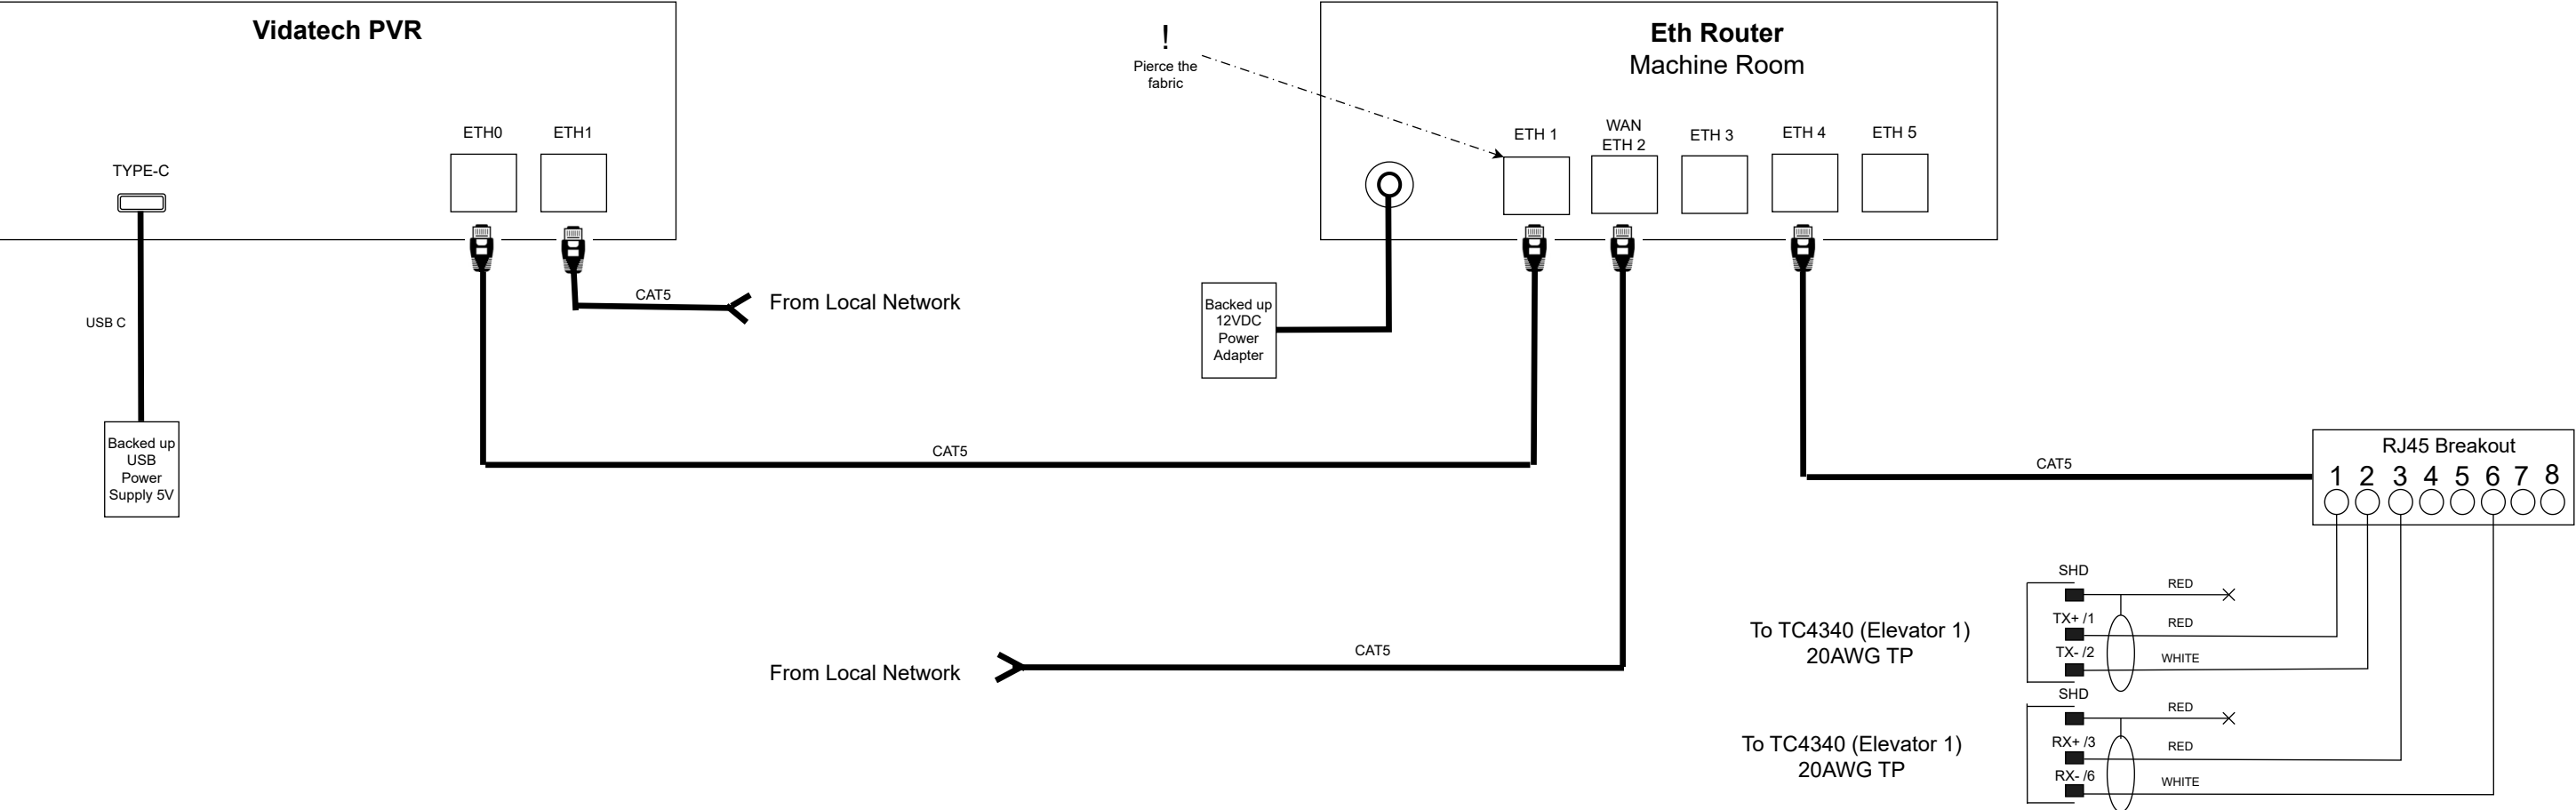

Line Monitoring Alarm

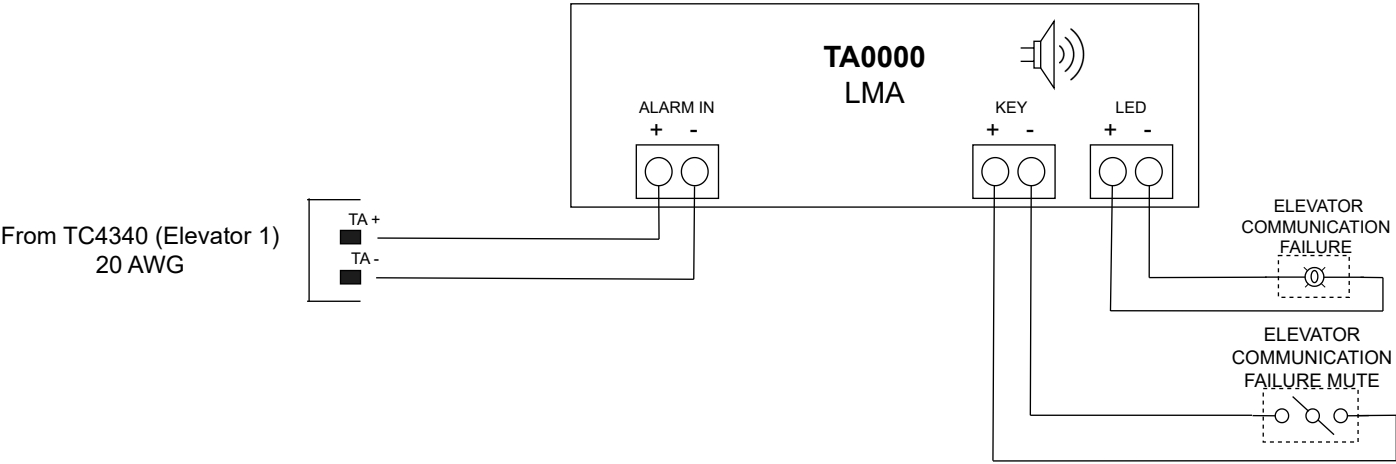


WIRE SIZES INDICATED ON THIS DRAWING ARE FOR REFERENCE ONLY. ALL WIRING DISCONNECT SWITCHES THAT ARE EXTERNAL TO THE PANEL MUST BE SIZED IN ACCORDANCE WITH THE LOCAL CODES. THIS PANEL IS SUITABLE FOR A CIRCUIT UNABLE TO DELIVER MORE THAN 15 AMPERES.

LULA TC4360 with PVR			
REV: 1.0	DESS. PAR:	P.-C.G.	DATE: 2026/08/12
	DRAWN BY:		
	VÉRIFIÉ. PAR:	A.M.	FEUILLE SHEET 1 DE OF 2



Elevator

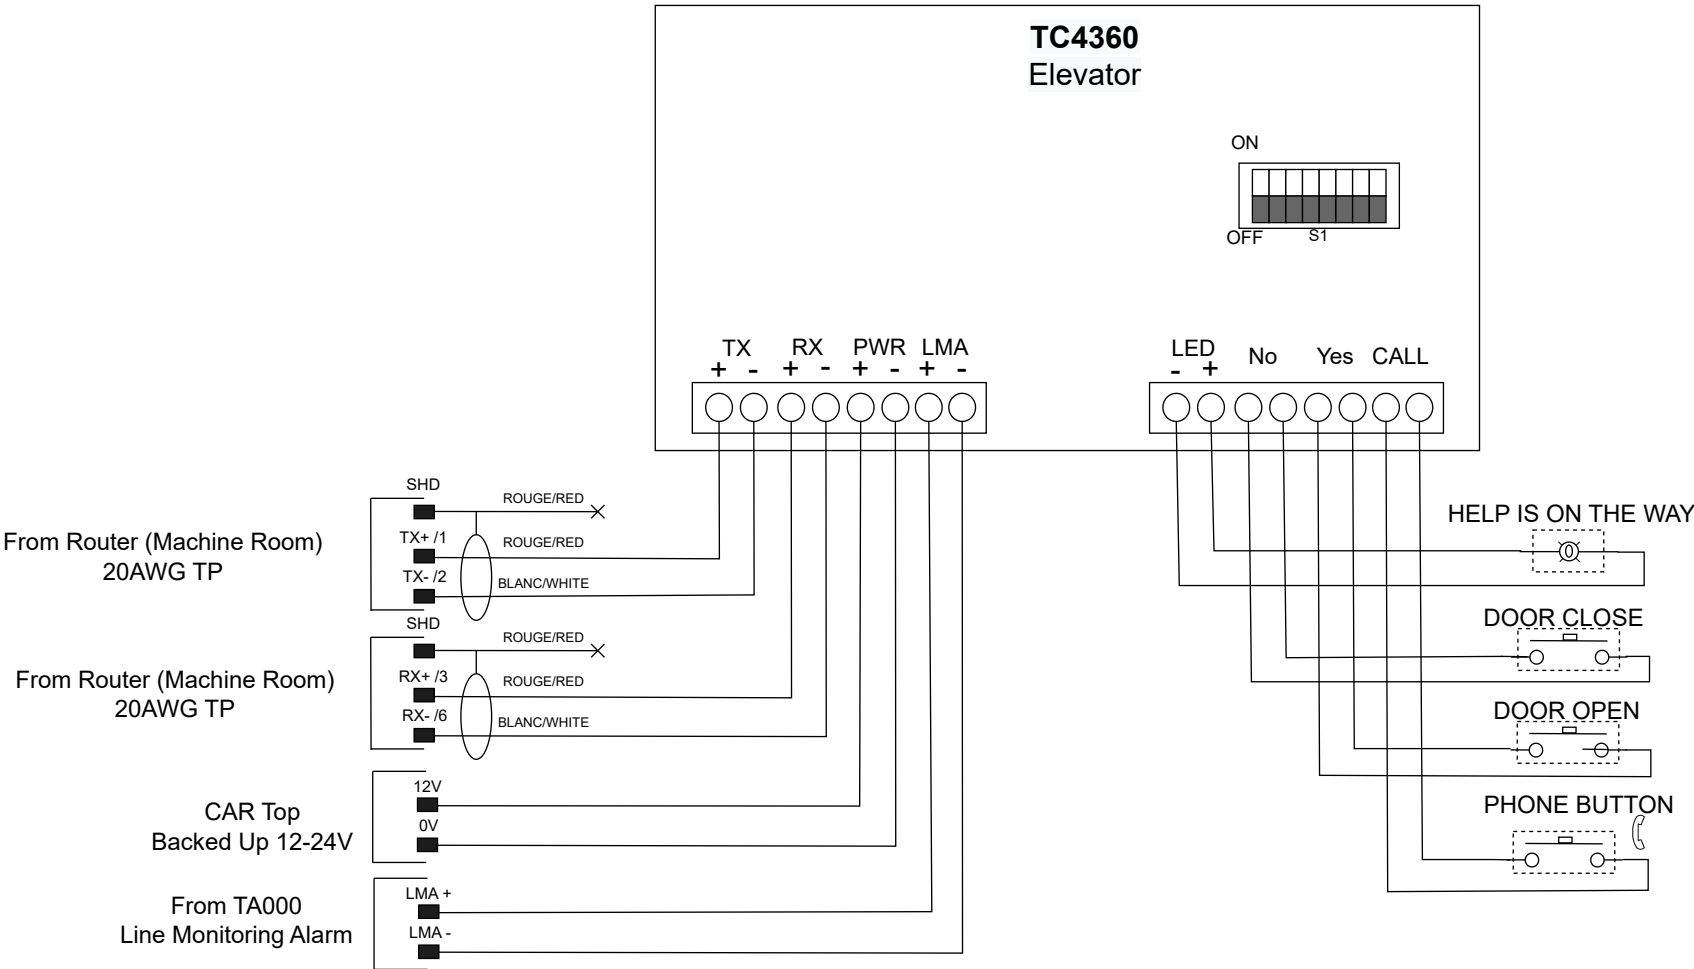

WIRE SIZES INDICATED ON THIS DRAWING ARE FOR REFERENCE ONLY. ALL WIRING DISCONNECT SWITCHES THAT ARE EXTERNAL TO THE PANEL MUST BE SIZED IN ACCORDANCE WITH THE LOCAL CODES. THIS PANEL IS SUITABLE FOR A CIRCUIT UNABLE TO DELIVER MORE THAN 15 AMPERES.

REV: 1.0

LULA TC4360 with PVR

DESS. PAR: DRAWN BY:	P.-C. G.	DATE:	2026/08/12
VÉRIFIÉ. PAR: VERIFIED BY:	A.M.	FEUILLE SHEET	2 DE OF 2

